

# DL/T645-2007 Standard

Website: <http://www.cw180.com>

## HMI Setting:

Parameters	Recommended	Options	Notes
PLC type	DL/T645-2007 Standard		
PLC I/F	RS485 2W		
Baud rate	9600		
Data bits	8		
Parity	Even		
Stop bits	1		
PLC sta. no.	1		

## PLC Setting:



DL/T645-2007多功能表通信协议


功能 操作 端口 其他

通讯地址: 201412110001 密码: 00000000 操作员代码: C0C1C2C3

数据标识	数据项名称	数据	单位	数据格式
04000103	最大需量周期	15分	分	NN
04000104	滑差时间	10分		

修改

- 电能量
  - 最大需量及发生时间
- 变量
  - 参变量
    - 日期及星期时间
    - 基本参数
    - 表常数表号版本
    - 每月结算日
    - 第一套第1时段表数据
    - 第一套第2时段表数据
    - 第一套第3时段表数据
    - 第一套第4时段表数据

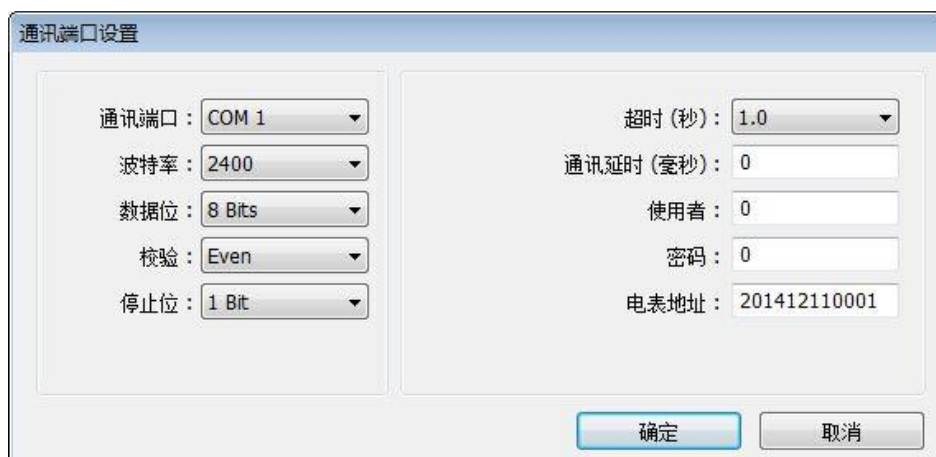

通讯端口设置

通讯端口: COM 1 超时(秒): 1.0

波特率: 2400 通讯延时(毫秒): 0

数据位: 8 Bits 使用者: 0

校验: Even 密码: 0

停止位: 1 Bit 电表地址: 201412110001

确定 取消

## System Tag:

<b>LW-10700 (4 words)</b>	DLT_645 operator (COM 1)
<b>LW-10704 (4 words)</b>	DLT_645 password (COM 1)
<b>LW-10708 (6 words)</b>	DLT_645 address (COM 1)
<b>LW-10715 (4 words)</b>	DLT_645 operator (COM 2)
<b>LW-10719 (4 words)</b>	DLT_645 password (COM 2)
<b>LW-10723 (6 words)</b>	DLT_645 address (COM 2)
<b>LW-10730 (4 words)</b>	DLT_645 operator (COM 3)
<b>LW-10734 (4 words)</b>	DLT_645 password (COM 3)
<b>LW-10738 (6 words)</b>	DLT_645 address (COM 3)

## Device Address:

Bit/Word	Device type	Format	Range	Memo
W	Data	HHHHHHHH	0 ~ 6FFFFFFF	

## Wiring Diagram:

RS-485 2W Terminal (Diagram 1 ~ Diagram 6)


### Diagram 1

**cMT Series**



**cMT3151**

**eMT Series**

**eMT3070 / eMT3105 / eMT3120 / eMT3150**

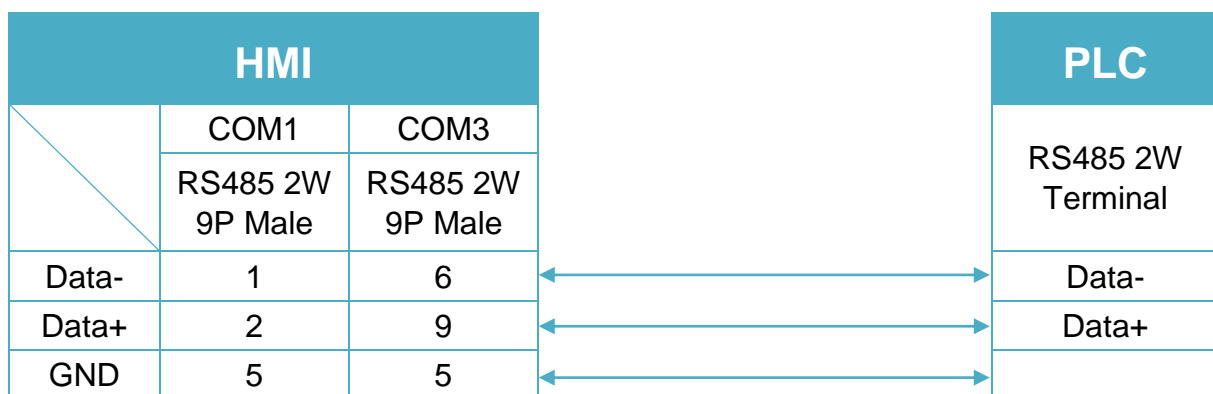

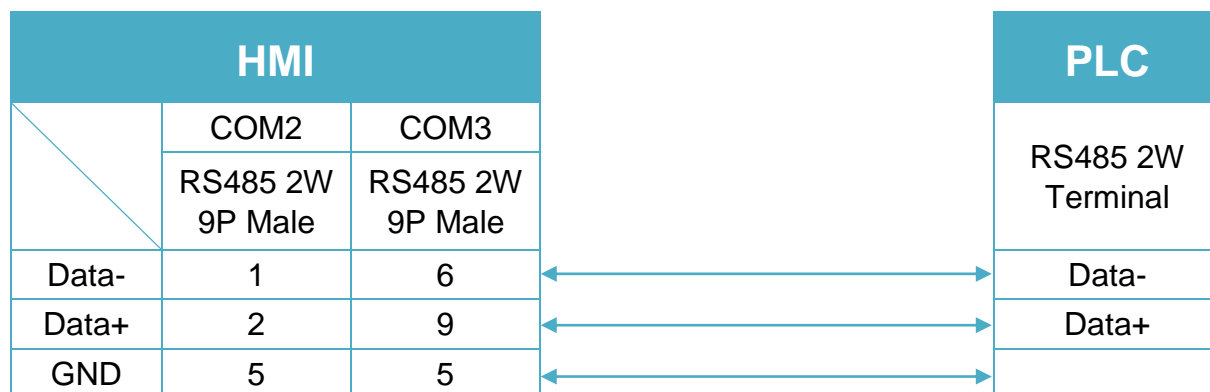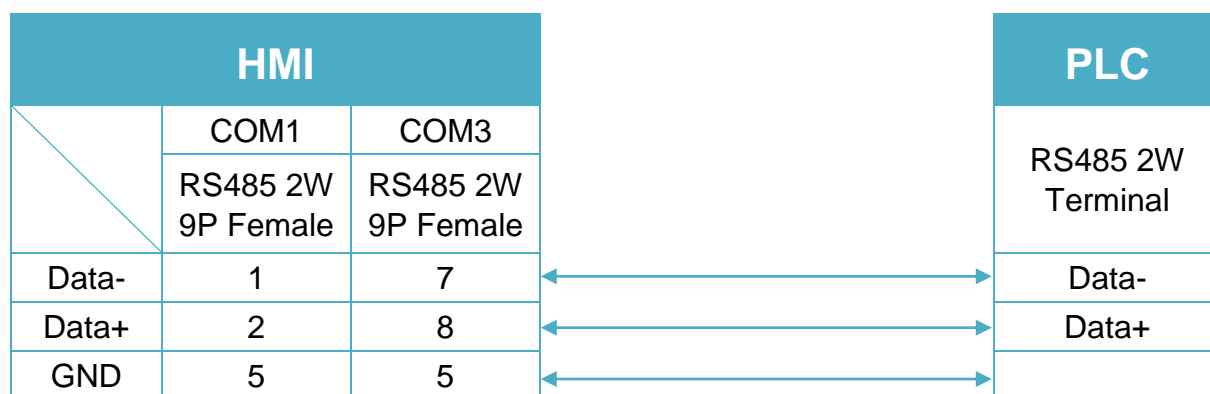


**Diagram 5**
**MT-iE**                      *MT8050iE / MT8053iE*
**MT-iP**                      *MT6051iP / MT8051iP*

**Diagram 6**
**MT-iP**                      *MT6071iP / MT8071iP*
