

# TINHAO

Website: [www.chinastrand.com](http://www.chinastrand.com)

## HMI Setting:

Parameters	Recommended	Options	Notes
PLC type	TINHAO		
PLC I/F	RS485 2W		
Baud rate	19200		
Data bits	8		
Parity	None		
Stop bits	1		
PLC sta. no.	1		

## Device Address:

Bit/Word	Device type	Format	Range	Memo
W	Commend1	DDD	0 ~ 255	
W	Commend2	DDD	0 ~ 255	
W	Commend3	DDD	0 ~ 255	
W	Commend4	DDD	0 ~ 255	
W	Commend5	DDD	0 ~ 255	
W	Commend6	DDD	0 ~ 255	
W	Commend7	DDD	0 ~ 255	
W	Commend8	DDD	0 ~ 255	
W	Commend9	DDD	0 ~ 255	
W	Commend10	DDD	0 ~ 255	
W	Commend11	DDD	0 ~ 255	
W	Commend12	DDD	0 ~ 255	
W	Commend13	DDD	0 ~ 255	
W	Commend14	DDD	0 ~ 255	
W	Commend15	DDD	0 ~ 255	
W	Commend16	DDD	0 ~ 255	
W	Commend17	DDD	0 ~ 255	
W	Commend18	DDD	0 ~ 255	
W	Commend19	DDD	0 ~ 255	
W	Commend20	DDD	0 ~ 255	
W	Commend21	DDD	0 ~ 255	
W	Commend22	DDD	0 ~ 255	

## Wiring Diagram:

RS-485 2W Terminal (Diagram 1 ~ Diagram 6)


### Diagram 1

**cMT Series**

***cMT3151***

**eMT Series**

***eMT3070 / eMT3105 / eMT3120 / eMT3150***

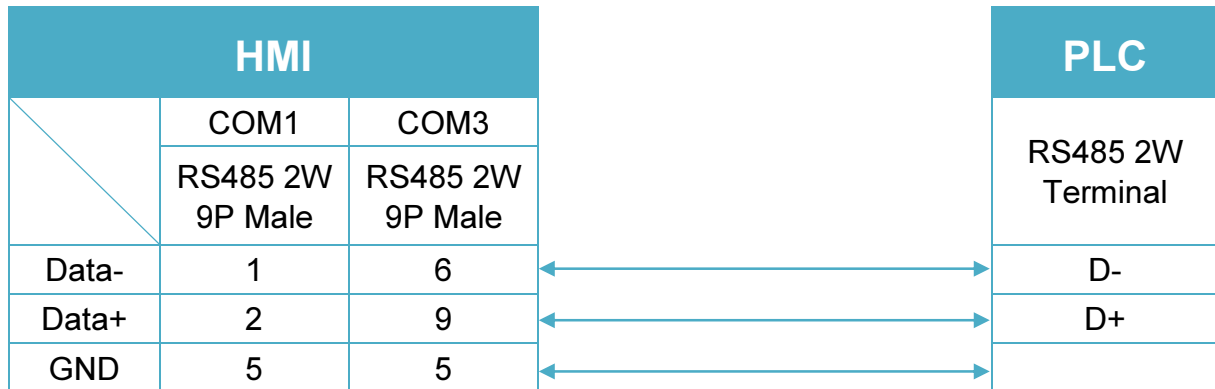


### Diagram 2

**cMT Series**

***cMT-SVR / cMT-G01 / cMT-G02 / cMT-HDM / cMT-FHD***

**mTV**


***mTV***

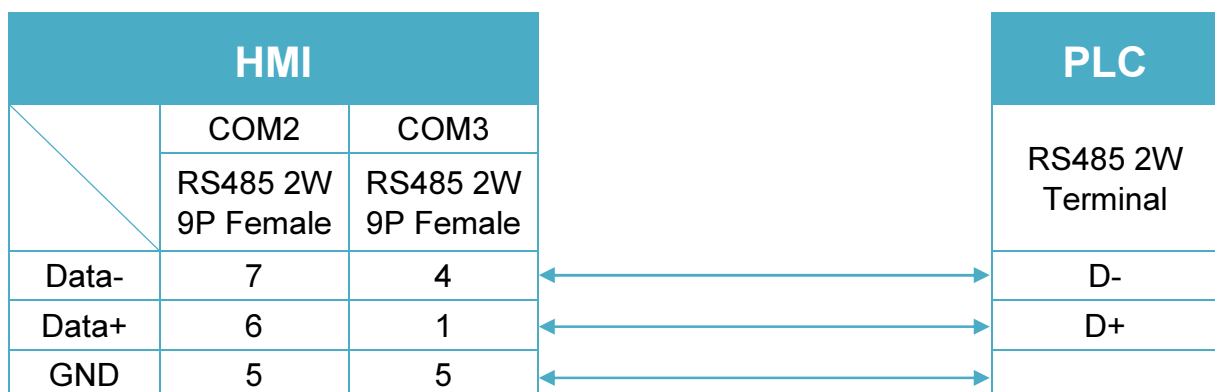

### Diagram 3

**MT-iE** *MT8070iE / MT6070iE / MT8100iE / MT8121iE / MT8150iE*

**MT-XE** *MT8121XE / MT8150XE*

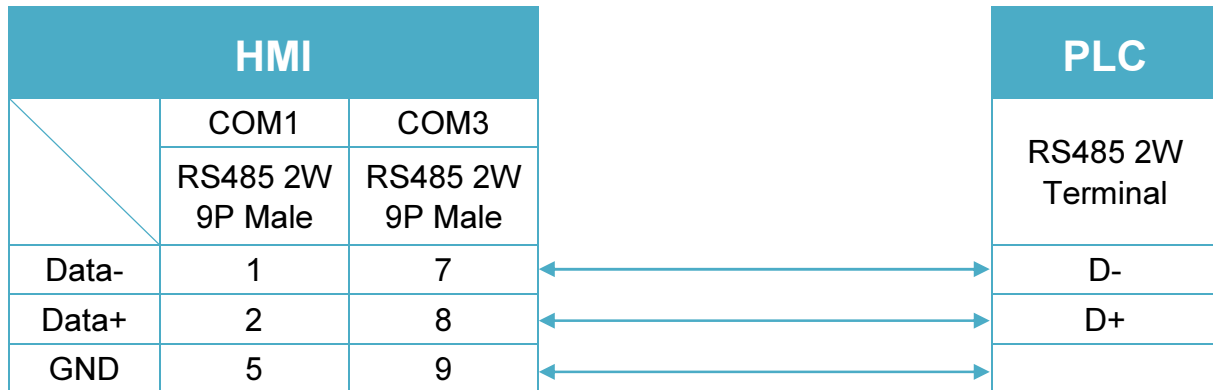


### Diagram 4

**cMT Series** *cMT3071 / cMT3072 / cMT3090 / cMT3103*

**MT-iE** *MT8071iE / MT6071iE / MT8072iE / MT6072iE / MT8073iE / MT8101iE / MT8102iE / MT8103iE*

**MT-XE** *MT8090XE / MT8092XE*


**MT-iP** *MT6103iP / MT8102iP*

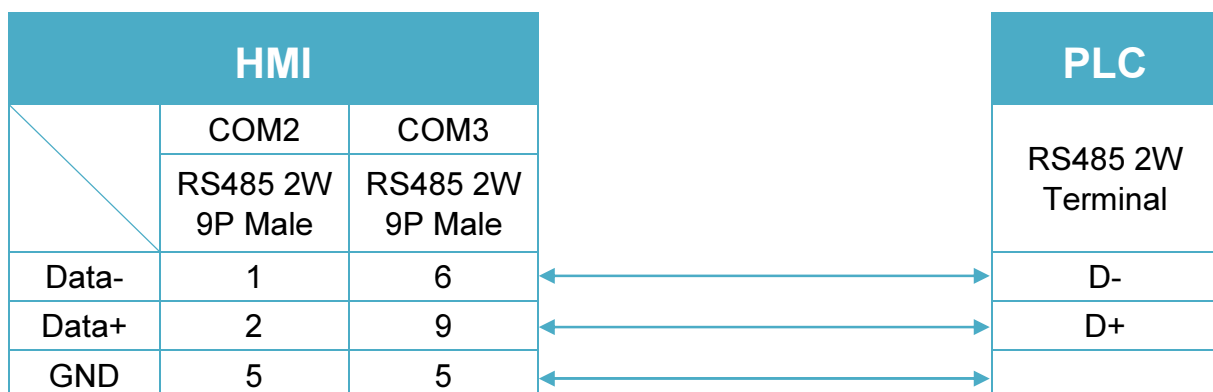

## Diagram 5

**MT-iE** *MT8050iE / MT8053iE*

**MT-iP** *MT6051iP / MT8051iP*

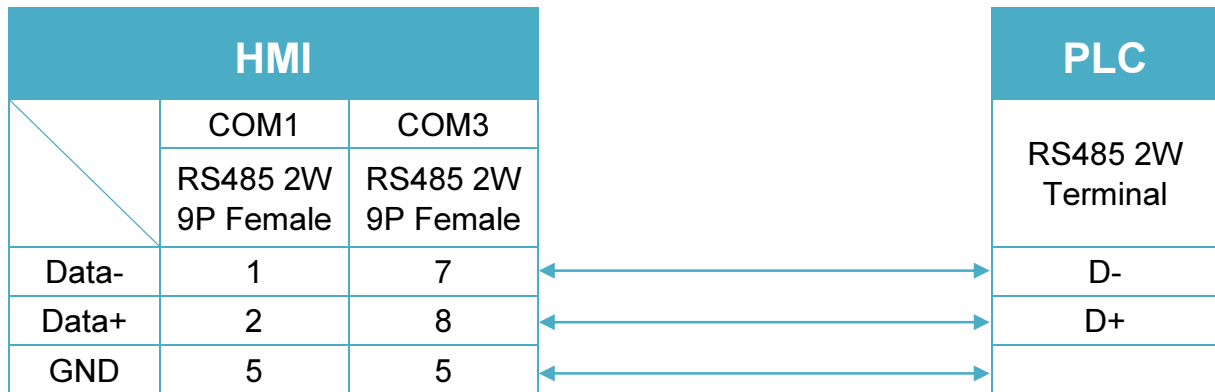

## Diagram 6

**MT-iP** *MT6071iP / MT8071iP*

